


Partner: Cool Automation
Model: 1000D or Compatible
Device Type: HVAC



GENERAL INFORMATION

SIMPLWINDOWS NAME:	CoolAutomation CoolMaster Thermostat Control v1.0.umc
CATEGORY:	HVAC
VERSION:	1
SUMMARY:	
GENERAL NOTES:	Suits generation 2 and 3 Crestron controllers
CRESTRON HARDWARE REQUIRED:	C2I-COM, ST-COM, C2-COM-* or CNX-COM2, any Crestron controller with 2-way RS232 port
SETUP OF CRESTRON HARDWARE:	RS232 Baud:9600 Parity: None Data Bits: 8 Stop Bits: 1
VENDOR FIRMWARE:	Unknown
VENDOR SETUP:	
CABLE DIAGRAM:	

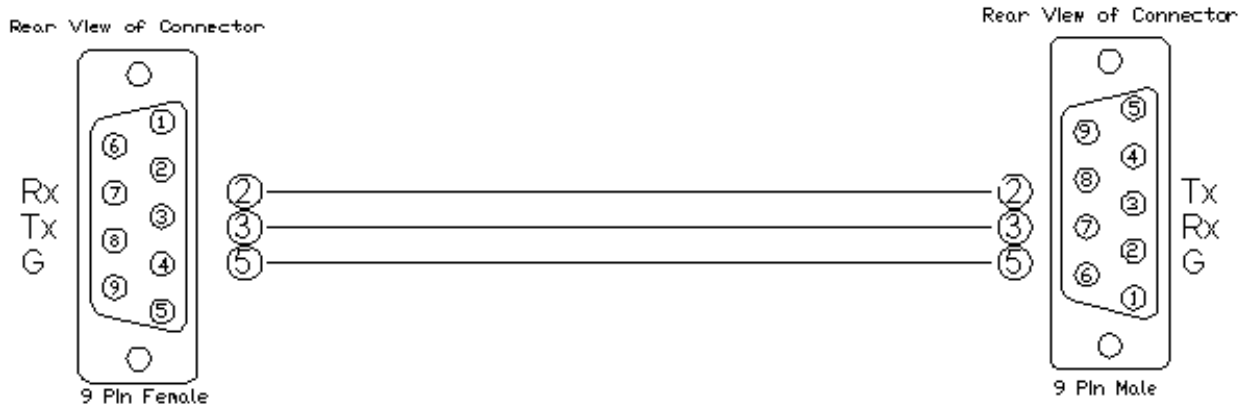

Partner: Cool Automation
Model: 1000D or Compatible
Device Type: HVAC



CONTROL:

Unit_ON_Press	D	Pulse to turn the unit ON.
Unit_OFF_Press	D	Pulse to turn the unit OFF.
Unit_Cool_Press	D	Pulse to set operation mode to Cool.
Unit_Heat_Press	D	Pulse to set operation mode to Heat.
Unit_Dry_Press	D	Pulse to set operation mode to Dry.
Unit_Fan_Press	D	Pulse to set operation mode to Fan.
Unit_Auto_Press	D	Pulse to set operation mode to Auto.
Unit_FanLow_Press	D	Pulse to set fan speed to Low.
Unit_FanMed_Press	D	Pulse to set fan speed to Medium.
Unit_FanHigh_Press	D	Pulse to set fan speed to High.
Unit_FanTop_Press	D	Pulse to set fan speed to Top.
Unit_FanAuto_Press	D	Pulse to set fan speed to Auto.
Unit_TempUP_Press	D	Pulse to increase setpoint temperature by 1 degree.
Unit_TempDown_Press	D	Pulse to decrease setpoint temperature by 1 degree.
Unit_SetTemp_Analog_Input	A	Change to set setpoint temperature.
Unit_Swing_Auto_Press	D	Pulse to set swing mode to Auto.
Unit_Swing_Horizontal_Press	D	Pulse to set swing mode to Horizontal.
Unit_Swing_30_Degrees_Press	D	Pulse to set swing mode to 30 degrees.
Unit_Swing_45_Degrees_Press	D	Pulse to set swing mode to 45 degrees.
Unit_Swing_60_Degrees_Press	D	Pulse to set swing mode to 60 degrees.
Unit_Swing_Vertical_Press	D	Pulse to set swing mode to Vertical.
Unit_Filt_Press	D	Pulse to indicate that the filter have been cleaned or replaced.
Celsius/Fahrenheit_Status	D	Latch high to indicate that the system is working with Fahrenheit degrees. That should be routed to the Celsius/Fahrenheit_fbck at the core module. It is very important since the string format differs depending on the mode.
toModules	S	Serial data signal to be routed from a 2 way com port.

Partner: Cool Automation
Model: 1000D or Compatible
Device Type: HVAC


FEEDBACK:

Unit_ON_fbck	D	Latches high to indicate that the unit is ON.
Unit_OFF_fbck	D	Latches high to indicate that the unit is OFF.
Unit_Cool_fbck	D	Latches high to indicate that the unit's operation mode is COOL.
Unit_Heat_fbck	D	Latches high to indicate that the unit's operation mode is HEAT.
Unit_Dry_fbck	D	Latches high to indicate that the unit's operation mode is DRY.
Unit_Fan_fbck	D	Latches high to indicate that the unit's operation mode is FAN.
Unit_Auto_fbck	D	Latches high to indicate that the unit's operation mode is AUTO.
Unit_FanLow_fbck	D	Latches high to indicate that the unit's fan speed is LOW.
Unit_FanMed_fbck	D	Latches high to indicate that the unit's fan speed is MEDIUM.
Unit_FanHigh_fbck	D	Latches high to indicate that the unit's fan speed is HIGH.
Unit_FanTop_fbck	D	Latches high to indicate that the unit's fan speed is TOP.
Unit_FanAuto_fbck	D	Latches high to indicate that the unit's fan speed is AUTO.
Unit_SetTemp_Analog_Output	A	Analog value of the setpoint temperature.
Unit_AMBTemp_Analog_Output	A	Analog value of the ambient temperature.
Unit_SetTemp_txt	S	Serial string representing the setpoint temperature.
Unit_AMBTemp_txt	S	Serial string representing the ambient temperature.
Unit_Swing_Auto_fbck	D	Latches high to indicate that the unit's swing mode is AUTO.
Unit_Swing_Horizontal_fbck	D	Latches high to indicate that the unit's swing mode is HORIZONTAL.
Unit_Swing_30_Degrees_fbck	D	Latches high to indicate that the unit's swing mode is 30 degrees.
Unit_Swing_45_Degrees_fbck	D	Latches high to indicate that the unit's swing mode is 45 degrees.
Unit_Swing_60_Degrees_fbck	D	Latches high to indicate that the unit's swing mode is 60 degrees.
Unit_Swing_Vertical_fbck	D	Latches high to indicate that the unit's swing mode is VERTICAL.
Unit_FiltSign_is_ON_fbck	D	Latches high to indicate that the filter sign is shown. That means that the filter of the unit should be cleaned or replaced.
fromModules	S	Serial data signal to be routed to core module.

Partner: Cool Automation
Model: 1000D or Compatible
Device Type: HVAC

**TESTING:**

OPS USED FOR TESTING:	Windows 8
SIMPL WINDOWS USED FOR TESTING:	4.001.10
DEVICE DB USED FOR TESTING:	47.05.005.00
CRES DB USED FOR TESTING:	37.00.013.00
SYMBOL LIBRARY USED FOR TESTING:	850
SAMPLE PROGRAM:	CoolAutomation CoolMaster v1.0 Demo MC3
REVISION HISTORY:	v1.0 – Initial Release